


SYSGuard 7070

8 Port Expansion Module

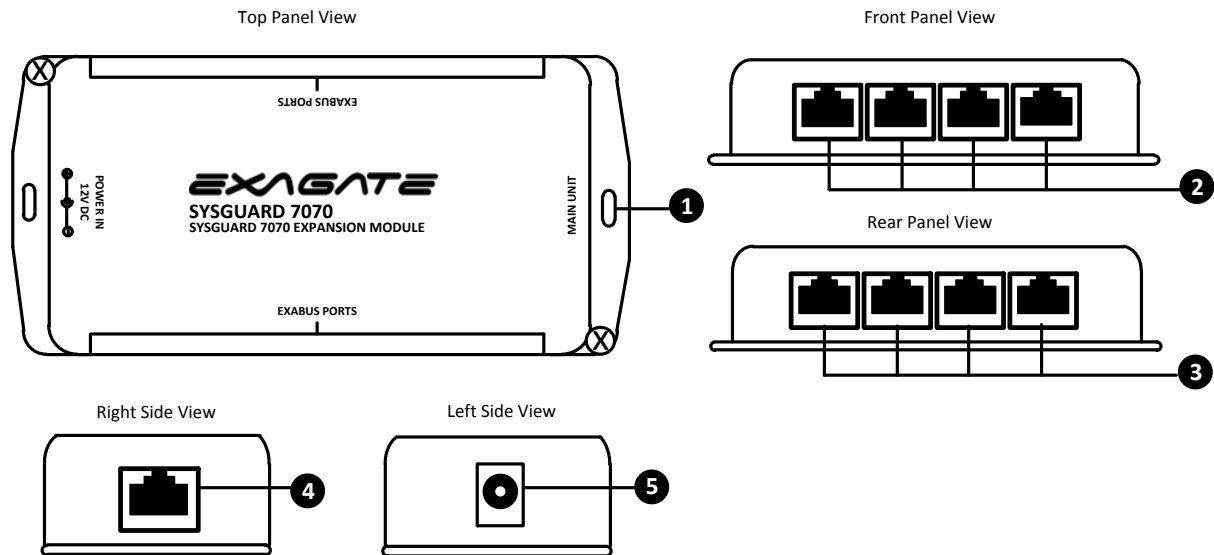

1 Assembly Hole

4 ExaBus Port Input

5 Power Input

2 3 ExaBus Ports

Product Info: Increases the number of sensors that can be added to the main unit.

Head Office

A: Sehit Ahmet Sokak No:12/1 Mecidiyekoy - Istanbul - Turkey
T: +90 212 275 73 22 F: +90 212 275 73 66
E: info@exagate.com

Support

support@exagate.com



Operational Properties

Power Supply Voltage	10,5 - 14,4 VDC typical 12 VDC
Power Consumption	0,020 - 0,024 A typical 0,022 A 0,210 - 0,350 W typical 0,250 W
Operational Temperature Range	-25 +70 °C
Operational Humidity Range	0 - 85 % Rh
Storage Temperature Range	-40 +85 °C
Storage Humidity Range	0 - 90 % Rh

Physical Properties

Dimensions (H x W x D)	31,5 x 57,6 x 106 mm 1,24 x 2,27 x 4,17 inches
Color	Grey
Weight	240 (+/-5%) grams

Technical Properties

Maximum Distance from Main Unit	200 m
External Device Input	YES – 8 Units
Power Over ExaBus Port	YES
ExaBus Port	1 Unit
Power Over External Device	YES (12V Power Adapter)
Supported External Devices	YES – All SYSGuard Sensors and Modules
Supported Main Units	SYSGuard 7001

Head Office


A: Sehit Ahmet Sokak No:12/1 Mecidiyekoy - Istanbul - Turkey
T: +90 212 275 73 22 F: +90 212 275 73 66
E: info@exagate.com

Support

support@exagate.com



Sample Connection Diagram

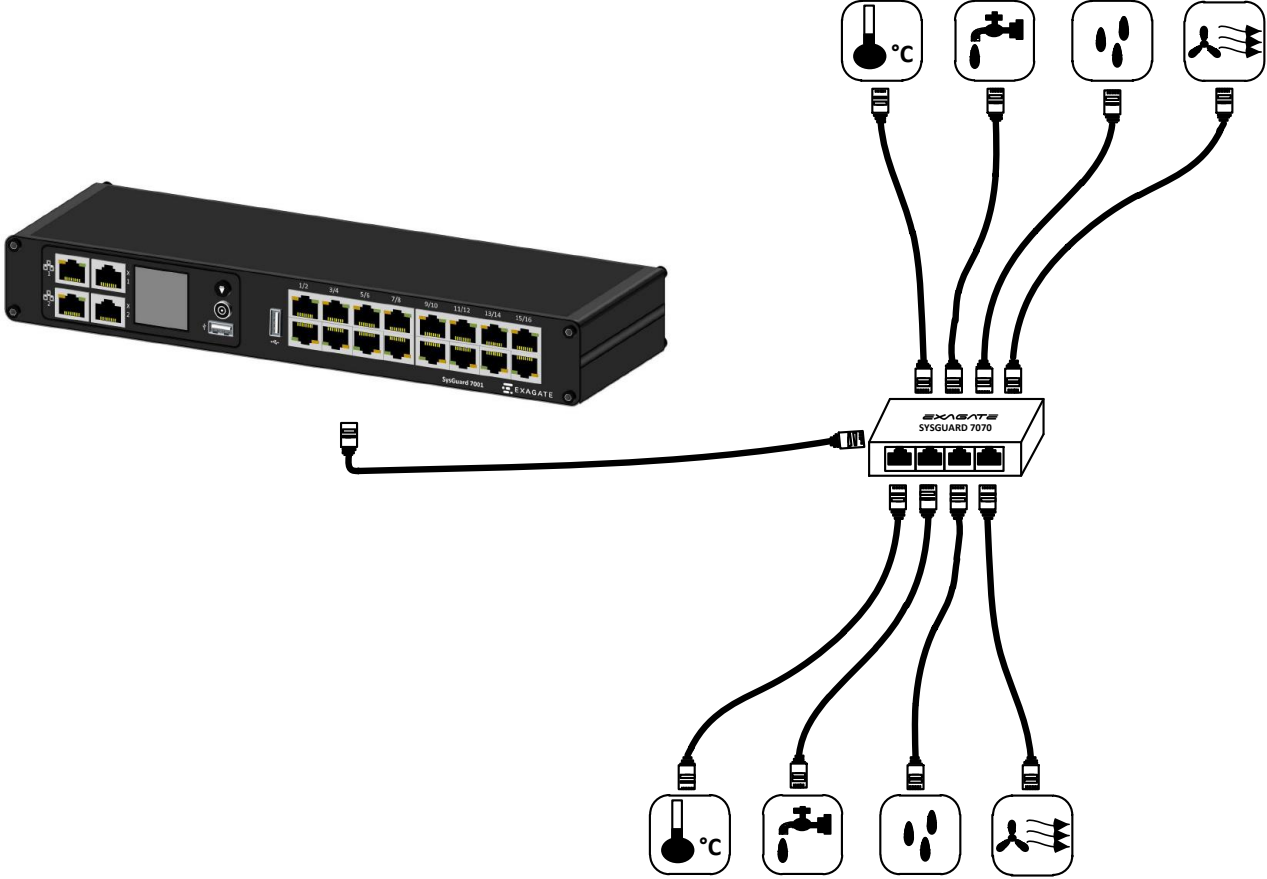

Head Office

A: Sehit Ahmet Sokak No:12/1 Mecidiyekoy - Istanbul - Turkey
T: +90 212 275 73 22 F: +90 212 275 73 66
E: info@exagate.com

Support

support@exagate.com



PRODUCT SKU #	BARCODE #	P/N	DESCRIPTION
SYSG7070	8699931601657	7270MO32005	Expansion Module

LIMITED PRODUCT WARRANTY

All ExaGate products are covered with 2 years limited guarantee from the date of original purchase. (Warranty duration may change depending on your country) Your sales or delivery receipt, showing the date of purchase of product is your proof of purchase. ExaGate is obliged to repair or replace the defective hardware (or any part of it's) with no charge to owner.

Conditions Void of Warranty

- Damages on unit, cable or screen.
- Defections due to electrical wiring and/or city network.
- Interference to unit by non-authorized staff.
- Any problems caused by act of nature.
- Misusage of unit stated by the user manual.
- Removal or destruction of serial number, warranty labels.
- Any kind of modifications on unit.

Head Office

A: Sehit Ahmet Sokak No:12/1 Mecidiyekoy - Istanbul - Turkey
T: +90 212 275 73 22 F: +90 212 275 73 66
E: info@exagate.com

Support

support@exagate.com

